



Town of Lowell
Building Department
501 East Main Street
Lowell, Indiana 46356


Phone: 219-696-7794
Email: Thenke@lowell.net
www.lowell.net

ELECTRICAL GUIDELINES FOR “ABOVE GROUND SWIMMING POOLS”

Overhead Electrical Lines

A swimming pool or spa installation must follow a couple of rules when it comes to overhead electrical lines:

- Utility power lines that run over a pool or spa must be at least 22.5 feet above the water level, base of a diving platform or observation platform.
- Communications cable must be at least 10 feet above the water level, base of a diving platform or observation platform.

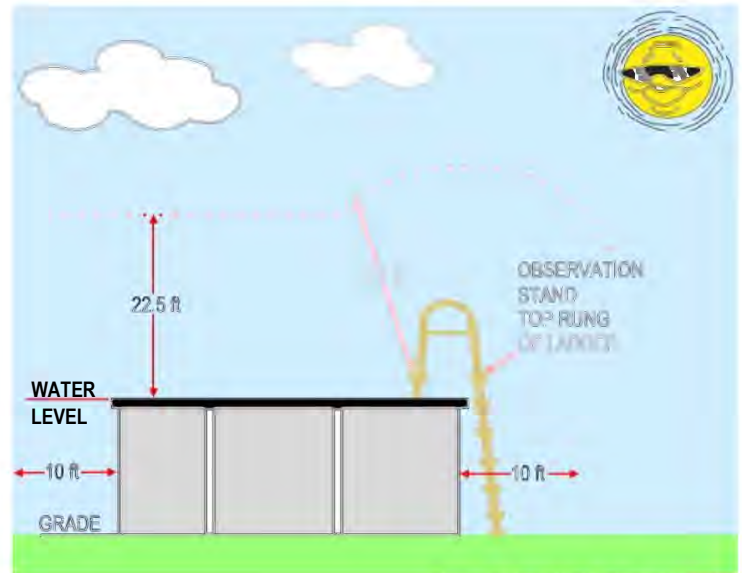

Reproduction of NEC Figure 680.8 (A)

For these rules, the water level is defined as the highest point water can reach before it spills out of the pool or spa. It is always preferable to install a pool or spa well away from any electrical lines, or vice versa. The water is one thing to worry about; another is the use of pool cleaning nets with very long, metal handles that you lift high into the air, which may accidentally come into contact with those overhead lines.

Underground Wiring


Underground wiring is not allowed under a pool, and can be run no closer than 5 feet from any sidewall of a pool.

There are some exceptions when the wiring attaches to the pool to serve equipment or lighting. When there is insufficient space in the area to maintain a 5-foot separation, wiring may be closer than 5 feet if it is installed in a complete raceway (conduit) system. Rigid metal raceway (RMC or IMC) must have at least 6 inches of cover. Nonmetallic raceway must have at least 6 inches of cover, including at least 4 inches of concrete; 18 inches minimum cover is required if the nonmetallic conduit is listed for direct burial without concrete encasement.



TOWN OF LOWELL

ELECTRICAL GUIDELINES FOR “ABOVE GROUND SWIMMING POOLS” ABOVE GROUND POOL BONDING / ELECTRICAL REQUIREMENTS

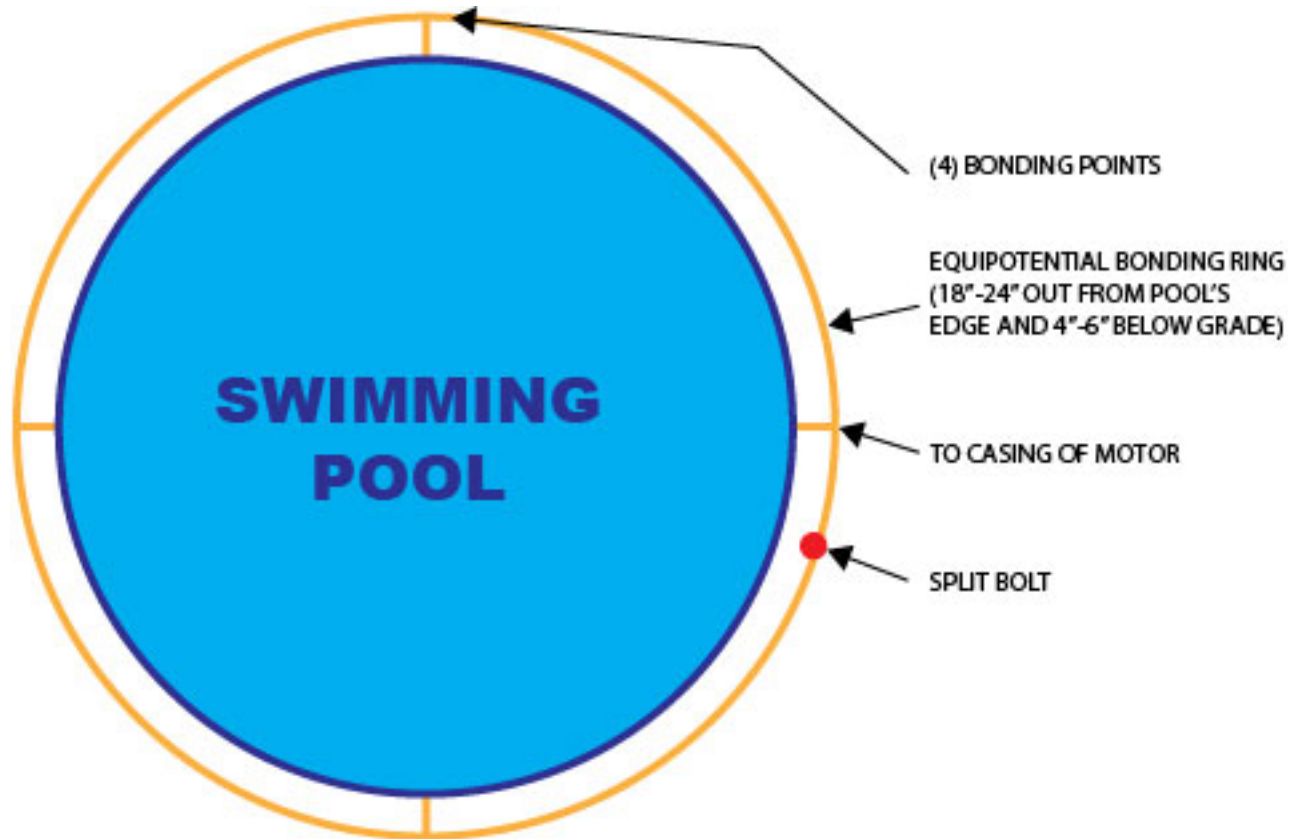

Equipotential Bonding Ring:

18-24 inches from the pool's edge and 4-6 inches below grade level. The grid shall be tied back to the pool (*if metal*) at four (4) equal points around the pool and shall extend back to the casing of the pool motor. Bonding wire shall be a minimum #8 copper (bare). Bonding of the pool water is also required by an approved method. (NEC 680.26 (B)(2)(4))

Wiring to pool pump:

Installed in an approved raceway and the wiring shall be approved for wet locations if installed in a corrosive environment. Where installed in a non-corrosive environment, the wiring method shall meet the requirements of Chapter 3 of the 2017 NEC. (NEC 300.5)

Conduit:

1. Buried eighteen 18-inches below grade for PVC *unless installed on a 120-volt; 20-amp GFCI circuit where the burial depth can be reduced to twelve 12- inches.* (NEC Table 300.5)
2. 6 inches below grade for Ridged conduit RMC/IMC. (NEC Table 300.5)

Receptacle:

A fifteen (15) or twenty (20) amp general-purpose receptacle shall be installed no closer than (6') six and no further than (20') twenty-feet from the pool edge and shall be a type WR and GFCI protected. (NEC 680.22).

Pool motor:

If plugged into a receptacle, then the receptacle shall be a type WR with an in-use cover. It shall be a minimum (6) six-feet from the pool and shall be GFCI protected. (NEC Article 680.22, 680.21, and 406.9)

Pool pump motor:

Flexible cord less than 3' with at least 12 AWG copper EGC. GFCI protected. (NEC Article 680.21(A)(5)).

Bonding of Pool Water:

Intentional bond of pool water required to be a minimum of 9 square inches. (NEC 680.26.7.C)


In-ground pool:

Comply with NEC 680.



TOWN OF LOWELL

ELECTRICAL GUIDELINES FOR “ABOVE GROUND SWIMMING POOLS”

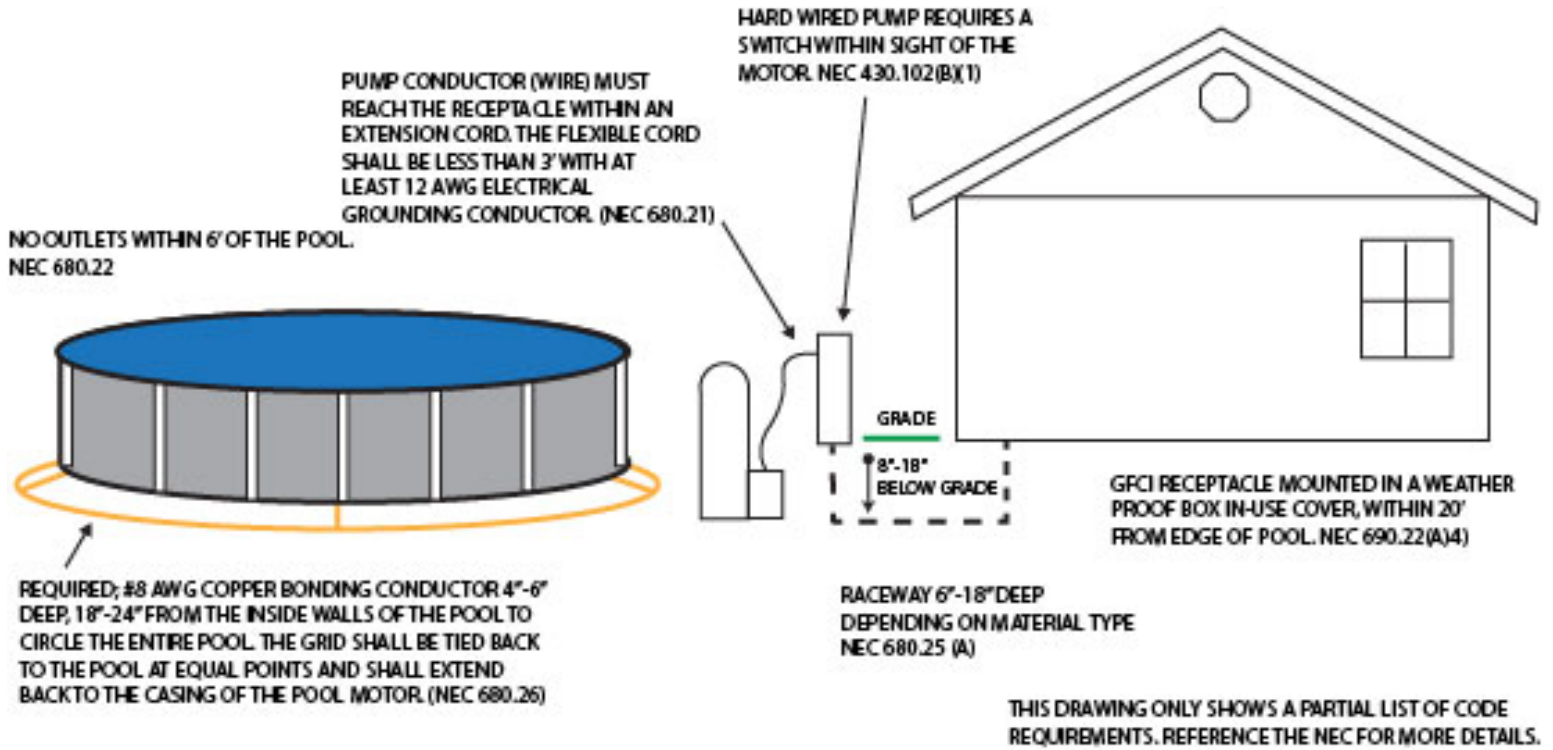




Town of Lowell

ELECTRICAL GUIDELINES FOR “ABOVE GROUND SWIMMING POOLS”

Electrical Outlet Receptacles


The rules for electrical outlets are aimed at preventing the possibility of shock:

- Receptacles for pumps and motors must be located between 6 and 10 feet from the pool walls, and they must be GFCI-protected and locked.
- Outlet receptacles for general use can be no closer than 20 feet from a pool or in-ground spa if they are not GFCI-protected, and no closer than 6 feet away if they are GFCI protected.

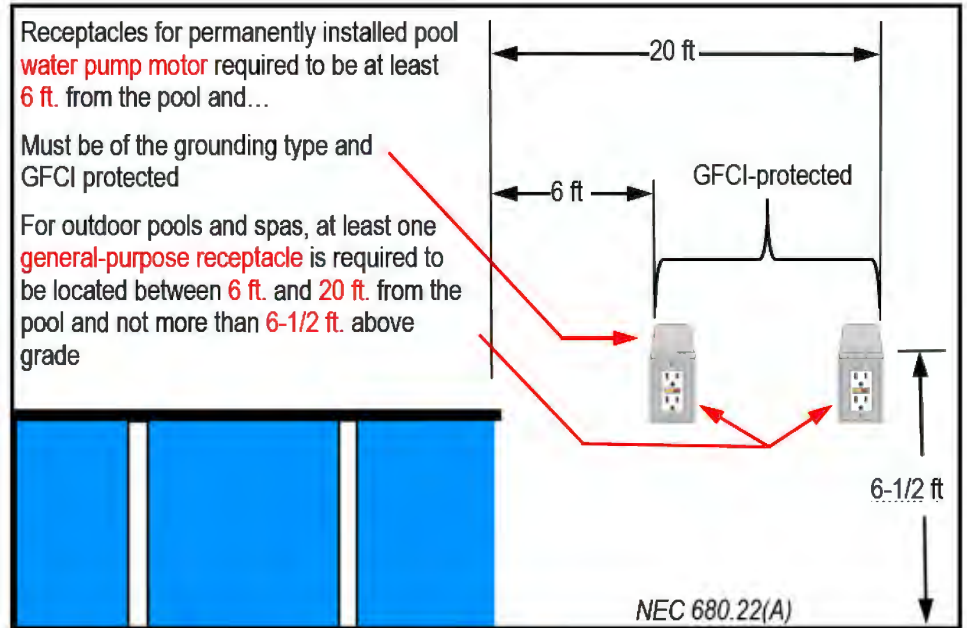

Maintenance Disconnect

A maintenance disconnect is required for shutting off power to pool or spa pumps, filters, and other utilization equipment. The disconnect must be installed within sight of the pool or spa but can be no closer than 5 feet from the pool or spa so that you cannot turn the power on or off while leaning out of the water.

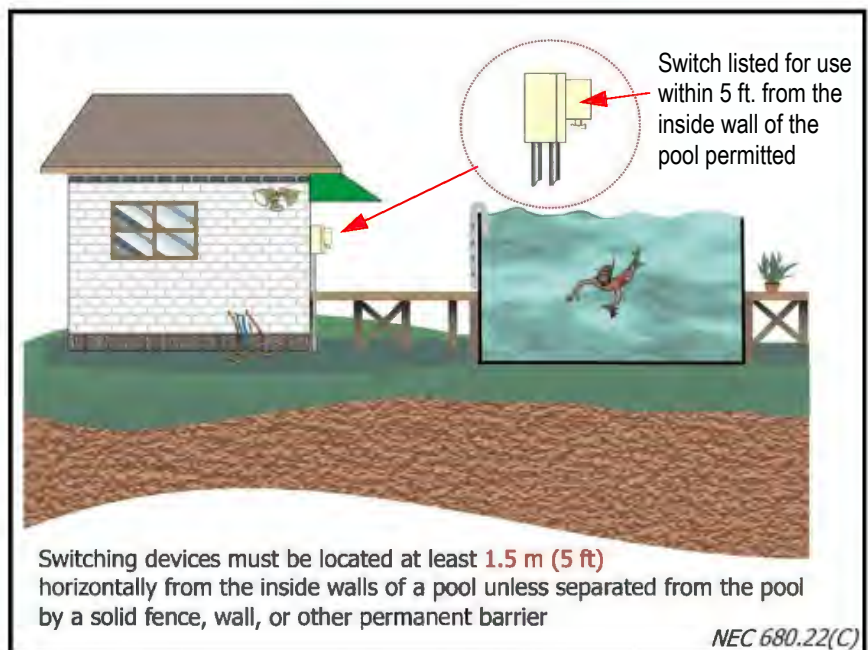



TOWN OF LOWELL

ELECTRICAL GUIDELINES FOR “ABOVE GROUND SWIMMING POOLS”

Electrical Bonding

Equipotential bonding requirements of NEC 680.26 are to reduce voltage gradients (difference of voltage potential between two conducting objects), not to create a grounding electrode system for a building or structure.


- This action essentially puts all metallic parts around and associated with the pool at the same voltage potential.
- Providing a path for ground-fault current is not the function of the equipotential bonding grid and associated bonding conductors.
- The structures and structural reinforcing steel of an in-ground swimming pool as described in NEC 680.26(B)(1) and (B)(2) are now prohibited from being used as a grounding electrode.

The equipotential bonding grid includes but not limited to:

- All metallic parts of the pool including structural reinforcing steel of the pool shell and perimeter surface (Tie wires are suitable for bonding of structural steel)
- All metal forming shells of underwater luminaires
- All metal fittings within or attached to the pool structure (Small parts exempted)
- Note: Isolated small parts not over 100 mm (4 in.) do not require bonding

Pool Water

If the pool water does not have an electrical connection to one of the bonded parts described in 680.26(B), an approved corrosion-resistant conductive surface that is at least 9 sq. in. must be in contact with the water. The corrosion-resistance conductive surface must be bonded in accordance with 680.26(B), and be located in an area where it will not be dislodged or damaged during normal pool usage.

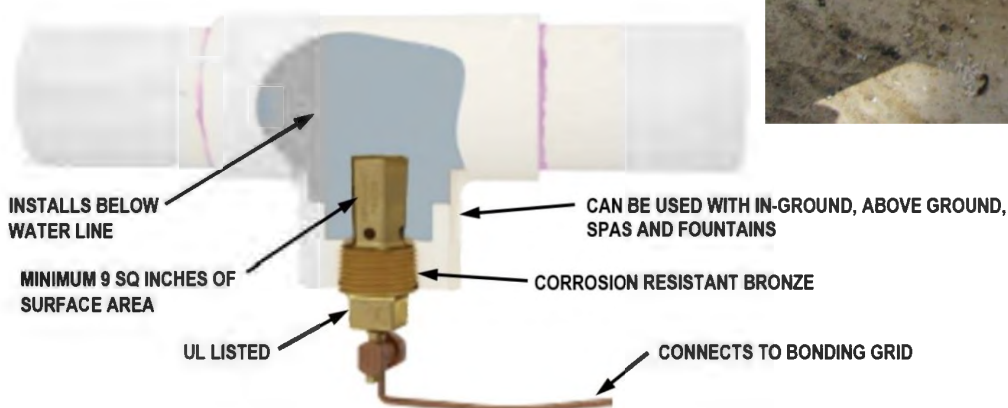



TOWN OF LOWELL

POOL HEATER PLUMBING 2020 INDIANA RESIDENTIAL CODE

G2415.12.1 (404.12.1) Individual Outdoor Appliances

- Individual lines to outdoor lights, grills and other appliances shall be installed not less than 8 inches (203 mm) below finished grade, provided that such installation is approved and is installed in locations not susceptible to physical damage.

G2415.17.1 (404.17.1) Limitations

Plastic pipe shall be installed outdoors underground only. Plastic pipe shall not be used within or under any building or slab or be operated at pressures greater than 100 psig (689 kPa) for natural gas or 30 psig (207 kPa) for LP-gas.

Exceptions:

1. Plastic pipe shall be permitted to terminate above ground outside of buildings where installed in premanufactured anodeless risers or service head adapter risers that are installed in accordance with the manufacturer's instructions.
2. Plastic pipe shall be permitted to terminate with a wall head adapter within buildings where the plastic pipe is inserted in a piping material for fuel gas use in buildings.
3. Plastic pipe shall be permitted under outdoor patio, walkway and driveway slabs provided that the burial depth complies with Section G2415.12.

G2420.5 (409.5) Appliance Shutoff Valve

Shall be within 6 feet of appliance